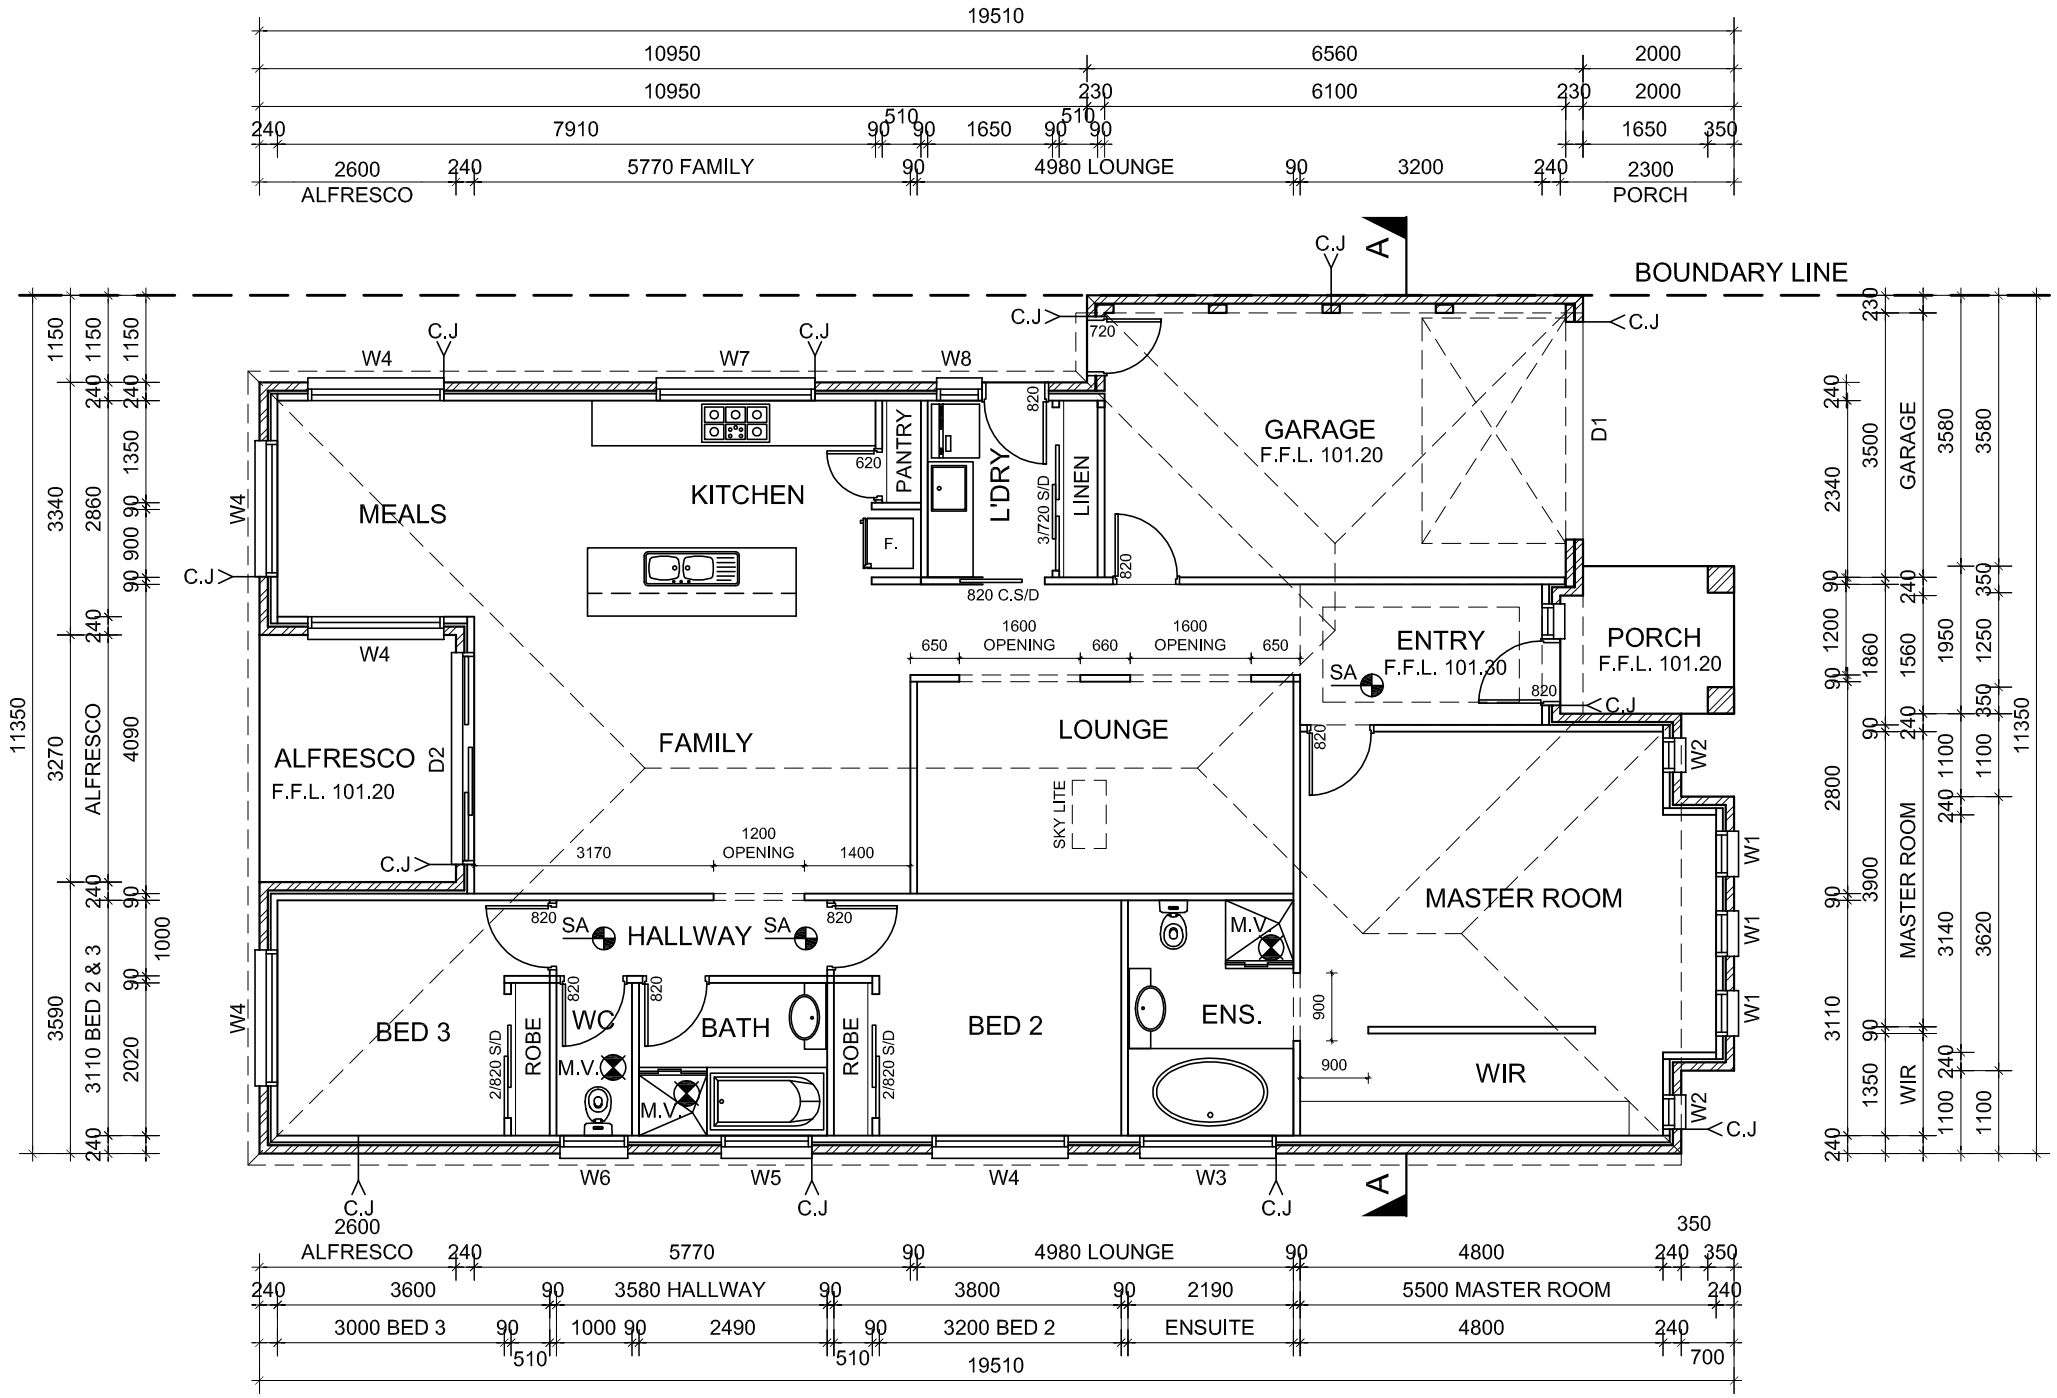

WINDOW & DOOR SCHEDULE

W1	600W x 1800H ALUMINUM FRAMED AWNING WINDOW
W2	450W x 1800H ALUMINUM FRAMED FIXIED WINDOW
W3	1800W x 900H ALUMINUM FRAMED SLIDING WINDOW (OBSECURE GLASS)
W4	1800W x 1200H ALUMINUM FRAMED SLIDING WINDOW
W5	1200W x 900H ALUMINUM FRAMED SLIDING WINDOW (OBSECURE GLASS)
W6	900W x 900H ALUMINUM FRAMED SLIDING WINDOW (OBSECURE GLASS)
W7	2100W x 450H ALUMINUM FRAMED FIXED WINDOW
W8	600W x 900H ALUMINUM FRAMED SLIDING WINDOW
D1	2900W x 2400H GARAGE PANEL LIFT DOOR (as selected)
D2	2800W x 2100H ALUMINUM FRAMED SLIDING DOOR

NOTE:

WINDOW SCHEDULE TO BE READ IN CONJUCTION WITH ELEVATIONS & ENERGY RATING.

ALL WINDOW HEAD HEIGHT TO BE AT 2100mm FROM F.F.L OR OTHERWISE NOTED.

ALL GLAZING SHALL BE CARRIED OUT IN ACCORDANCE WITH AS 1288 - 1994 GLASS INSTALLATION CODE & THE B.C.A.

NOTES:

TOILET DOORS TO COMPLY WITH B.C.A. 3.8.3.3 TO OPEN OUTWARDS, SLIDE OR BE REMOVABLE FROM THE OUTSIDE IF LESS THAN 1.2 M. BETWEEN THE PAN & DOOR FRAME

THESE DRAWINGS ARE TO BE READ IN CONJUCTION WITH ENGINEERING DRAWINGS ETC.

REFER TO ENGINEERS DRAWINGS FOR ALL LOCATION OF BEAMS AND LINTELS

ALL DIMENSIONS AND LEVELS TO BE CHECKED BEFORE COMMENCING WORK.

LEGEND

M.V.	ALL MECHANICAL VENTILATION TO BE 200 Ø MIN FAN AND TO EXTRACT 10 LT./SEC. MIN DUCTED TO EXTERNAL AIR.
SA	SMOKE DETECTORS TO BE HARD WIRED TO THE ELECTRICAL MAIN SYSTEM
C.J	CONTROL JOINT

GROUND FLOOR PLAN 1:100